

इंटरनेट

मानक

Disclosure to Promote the Right To Information

Whereas the Parliament of India has set out to provide a practical regime of right to information for citizens to secure access to information under the control of public authorities, in order to promote transparency and accountability in the working of every public authority, and whereas the attached publication of the Bureau of Indian Standards is of particular interest to the public, particularly disadvantaged communities and those engaged in the pursuit of education and knowledge, the attached public safety standard is made available to promote the timely dissemination of this information in an accurate manner to the public.

“जानने का अधिकार, जीने का अधिकार”

Mazdoor Kisan Shakti Sangathan

“The Right to Information, The Right to Live”

“पुराने को छोड़ नये के तरफ”

Jawaharlal Nehru

“Step Out From the Old to the New”

IS 4990 (2011): Plywood for concrete shuttering work - Specification [CED 20: Wood and other Lignocellulosic products]



“ज्ञान से एक नये भारत का निर्माण”

Satyanarayan Gangaram Pitroda

“Invent a New India Using Knowledge”



“ज्ञान एक ऐसा खजाना है जो कभी चुराया नहीं जा सकता है”

Bhartrhari—Nitiśatakam

“Knowledge is such a treasure which cannot be stolen”

BLANK PAGE



भारतीय मानक
कंक्रीट शटरिंग कार्य के लिए प्लाईवुड — विशिष्टि
(तीसरा पुनरीक्षण)

Indian Standard

PLYWOOD FOR CONCRETE SHUTTERING
WORKS — SPECIFICATION
(*Third Revision*)

ICS 79.060.10

© BIS 2011

BUREAU OF INDIAN STANDARDS
MANAK BHAVAN, 9 BAHADUR SHAH ZAFAR MARG
NEW DELHI 110002

FOREWORD

This Indian Standard (Third Revision) was adopted by the Bureau of Indian Standards, after the draft finalized by the Wood and Other Lignocellulosic Products Sectional Committee had been approved by the Civil Engineering Division Council.

Plywood for concrete shuttering works is a BWP grade plywood, preservative treated and specially suited for use in concrete shuttering and form work. Concrete shuttering plywood is very economic as it can be put to repeated use, depending upon the care taken during erection and dismantling. The main requirements of such plywood are that it should be durable under alternate wetting and drying conditions, its surface should be hard and it should possess adequate strength to withstand the load of concrete and the forces caused by pouring of concrete and vibrations. This standard specifies the requirements of such plywood for use in concrete shuttering and form work and provides guidance in the manufacture and use of the plywood.

This standard was first published in 1969 and revised in 1981 and 1990. In the second revision, the major changes incorporated were:

- a) Use of any species of timber was permitted subject to fulfillment of other requirements of the standard;
- b) Three types of plywood, namely Type 1 (Plain), Type 2 (Coated), and Type 3 (Film faced) was specified;
- c) Minimum thickness of face veneer was specified;
- d) Amount of phenol formaldehyde or cresole formaldehyde to be used for making plywood for concrete shuttering with plastic coating or with suitable overlay was redefined; and
- e) Requirement for modulus of elasticity and corresponding tests was included.

The present revision has been undertaken to incorporate changes based on developments that have taken place and the experience gained in manufacture and use of the product over the years. The following major changes have been incorporated in this revision:

- a) An alternate accelerated test for water resistance has been introduced;
- b) New test requirement for wet bending strength has been specified and test method has been included; and
- c) Requirements for glue shear strength have been specified against different percentages of average wood failure observed.

This standard also includes in Annex E, on recommended method for handling, storing and use of plywood for concrete shuttering and form work.

In the formulation of this standard, due weightage has been given to international coordination among the standards and practices prevailing in different countries in addition to relating it to the practices in the field in this country.

A scheme of labelling environment friendly products to be known as ECO-Mark has been introduced at the instance of the Ministry of Environment and Forests (MEF), Government of India. The ECO-Mark shall be administered by the Bureau of Indian Standards under the *BIS Act*, 1986 as per the Resolution No. 71 dated 21 February 1991 and Resolution No. 425 dated 28 October 1992 published in the Gazette of the Government of India. For a product to be eligible for ECO-Mark, it shall also carry the Standard Mark of the BIS besides meeting additional environment friendly requirements. For this purpose, the Standard Mark of BIS would be a single mark being a combination of the ISI Mark and the ECO logo. Requirements to be satisfied for a product to qualify for the BIS Standard Mark for ECO friendliness will be optional; manufacturing units will be free to opt for ISI Mark alone also.

The requirements pertaining to ECO criteria are based on the Gazette Notification No. 170 dated 18 May 1996 for wood substitutes as environment friendly products published in Gazette of Government of India.

The composition of the Committee responsible for the formulation of the standard is given in Annex F.

For the purpose of deciding whether a particular requirement of this standard is complied with, the final value, observed or calculated, expressing the result of a test or analysis, shall be rounded off in accordance with IS 2 : 1960 'Rules for rounding off numerical values (*revised*)'. The number of significant places retained in the rounded off value should be the same as that of the specified value in this standard.

*Indian Standard***PLYWOOD FOR CONCRETE SHUTTERING
WORKS — SPECIFICATION***(Third Revision)***1 SCOPE**

This standard covers the requirements of plywood for concrete shuttering and form work.

2 REFERENCES

The standards listed in Annex A contain provisions which through reference in this text, constitute provisions of this standard. At the time of publication, the editions indicated were valid. All standards are subject to revision and parties to agreements based on this standard are encouraged to investigate the possibility of applying the most recent editions of the standards indicated in Annex A.

3 TERMINOLOGY

For the purpose of this standard, the definitions given in IS 707 shall apply.

4 TYPES

Plywood for concrete shuttering work shall be preservative treated, of BWP grade and shall be of three types as given below:

<i>Type</i>	<i>Description</i>	<i>Designation</i>
(1)	(2)	(3)
1	Plywood for concrete shuttering work (Plain)	CS
2	Plywood for concrete shuttering work with plastic coating (Coated)	CSC
3	Plywood for concrete shuttering work with suitable overlay (Film faced)	CSFF

5 MATERIALS**5.1 Timber**

Any species of timber may be used for manufacture of plywood for concrete shuttering works. However a list of species given in Annex B may be used for selection of species. For ECO-Mark only species of wood from sources other than natural forests such as wood from rubber, coconut, cashew, industrial and social forestry

plantations, etc, shade trees from tea and coffee estates shall be used for the manufacture of plywood.

5.2 Adhesives for Bonding of Veneers

The adhesive used for bonding shall be of the hot press synthetic resin (phenol formaldehyde) type and shall conform to BWP type specified in IS 848. Extenders shall not be added to the adhesive. Addition of a dye to the adhesive to check that all the parts of the veneer are completely covered by adhesive shall be permissible. Addition of a filler not exceeding 5 percent shall be permissible provided the filler does not detract from the water resistance of the adhesive.

6 MANUFACTURE

6.1 Veneers for the manufacture of plywood for concrete shuttering works shall be either rotary cut or sliced, but preferably rotary cut. The veneers shall be reasonably smooth to permit an even spread of glue. The veneers shall be dried to a moisture content not exceed 6 percent before bonding. The glue shall be evenly spread. The veneers shall then be assembled with alternate layers at right angles to each other (except in the case of even number of veneers when the two central veneers are in the same direction) and hot pressed under controlled conditions of temperature, pressure and pressing time. The core veneers shall not have open joints or splits beyond the limits prescribed in **8.2**. No unglued area shall be found on separation of the veneers. The two face veneers shall run in the same direction and the assembly shall be balanced around the central plane of plywood.

6.1.1 The veneers may have sound knots of diameter not exceeding 50 mm. Tight fitted patches, with distance from one patch to the other not less than 0.6 m, shall be permitted, but maximum diameter of any patch shall not exceed 40 mm. The number of pin-holes on face veneers shall not be more than 10 in any square metre of the surface. Harmless discolouration may be permitted, but loose knots and dry-rot shall not be permitted (*see 8.1*).

6.2 The thickness of all individual veneers shall be uniform with a variation of ± 5 percent. The veneer shall

be straight grained within a permitted slope of $\pm 10^\circ$. Veneers with same distance from the central plane shall be of same thickness.

6.3 Thickness of face veneer shall not be less than 1.2 mm.

6.4 Plywood for concrete shuttering work shall be preservative treated and bonded with BWP adhesive. When required, concrete shuttering plywood may be supplied with or without any plastic coating or suitable overlay (*see* 6.7 and 10.1.4).

6.5 When boards of a size larger than the available press size are required, these may be made by scarf jointing the finished board, the scarf being through the thickness of the board.

6.5.1 All scarf joints shall be bonded with adhesives conforming to IS 848, having similar properties to those used in the bond of veneers. Scarf joints shall be made with 1 : 8 slope.

6.6 The plywood after manufacture shall be given a preservative treatment as covered by IS 5539 and conditioned to a moisture content not exceeding 15 percent. The preservative used shall have a copper-chrome-arsenic (CCA) composition or copper-chrome-boron (CCB) composition or acid-copper-chrome (ACC) composition, with retention of not less than 12 kg/m³.

6.7 Plywood for concrete shuttering work with plastic coating, or with suitable overlay shall be made with a surface film of phenol formaldehyde or creosol formaldehyde resin, either carried by tissue paper or evenly spread by a mechanical spreader with resin content not less than 100 g/m² (Paper weight : total weight shall be at least 1:1.5), which is subsequently cured under heat and pressure to give a smooth and waterproof surface. The film shall be applied on the surface of preservative treated plywood after manufacture. The pressing shall be such that the film uniformly melts and finishes into a smooth and hard surface on the plywood.

7 DIMENSIONS AND TOLERANCES

7.1 The dimensions of the plywood boards shall be as given in 7.1.1.

7.1.1 The first dimension shall represent the length, that is, the dimension parallel to the grain of the faces as given in 7.2; the second, the width as given in 7.2; and the third the thickness, as given in 7.3.

7.2 Size

Unless otherwise specified, plywood boards for concrete shuttering work shall be of length and width

as specified below:

2 400 mm × 1 200 mm	1 500 mm × 1 200 mm
2 400 mm × 900 mm	1 500 mm × 900 mm
2 100 mm × 1 200 mm	1 200 mm × 1 200 mm
2 100 mm × 900 mm	1 200 mm × 900 mm
1 800 mm × 1 200 mm	1 200 mm × 600 mm
1 800 mm × 900 mm	900 mm × 900 mm

7.3 Thickness

Unless otherwise specified, thickness of board shall be as specified below for respective number of plies:

Board (1)	Thickness mm (2)
3-ply	4
	5
	6
5-ply	6
	8
	9
7-ply	12
	16
9-ply	16
	19
	22
More than 9-ply	25
	30
	35
	40

NOTE — Any other dimensions (length, width and thickness) as agreed to between the manufacturer and the purchaser may be used.

7.4 Tolerances

Tolerances on the nominal sizes of finished boards shall be as follows:

Dimension (1)	Tolerance (2)
Length	: $\begin{matrix} +6 \\ -0 \end{matrix}$ mm
Width	: $\begin{matrix} +3 \\ -0 \end{matrix}$ mm
Thickness:	
a) Less than 6 mm	: ± 10 percent
b) 6 mm and above	: ± 5 percent
Edge straightness	: 2 mm/1 000 mm or 0.2 percent
Squareness	: 2 mm/1 000 mm or 0.2 percent

NOTE — Edge straightness and squareness shall be tested as per Annex C.

8 WORKMANSHIP AND FINISH

8.1 The plywood for concrete shuttering work shall be smooth and the faces and back shall be free from harmful discolouration, pleats, overlaps and loose knots. The edges shall be of smooth uniform finish.

8.2 Gaps and open joints shall be permitted as follows:

- a) *In face* — The gap or opening shall not exceed a width of 0.4 mm. If it exceeds 0.4 mm, this may be rectified by well-fitted veneer inserts of suitable width provided the grain of the veneer insert does not deviate by more than 10 percent from the grain direction of the surrounding veneer.
- b) *In core (cross-band)* — The width of the opening shall not exceed 1 mm in the case of 3-ply and 5-ply, and 2 mm in the case of plywood of more than 5-ply, provided such openings are not less than 300 mm apart in any veneer and staggered not less than 150 mm between any veneer and the next one with the same grain direction.

8.3 The faces of plywood for concrete shuttering work with plastic coating, or with suitable overlay, shall be dense, smooth and without blisters and patch marks. It shall be of uniform colour.

9 SAMPLING

The method of drawing representative samples, sample size and the criteria for conformity shall be as prescribed in IS 7638.

10 TESTS

10.1 The test pieces, cut from each of the boards selected as specified in **9**, shall be subjected to the tests specified under **10.1.1** to **10.1.9**.

10.1.1 Moisture Content

The average moisture content of three test pieces cut out from each board selected as in **9**, when tested in accordance with IS 1734 (Part 1), shall be not less than 5 percent and not more than 15 percent.

10.1.2 Glue Adhesion in Dry State

10.1.2.1 Glue shear strength

Six test specimens from each pair of glue lines shall be tested in accordance with the method described in IS 1734 (Part 4). The average failing load shall be not less than the corresponding values specified in Table 1.

10.1.2.2 Adhesion of plies

Adhesion shall be tested by knife test method described in IS 1734 (Part 5). The adhesion of plies may also be tested by forcibly separating the layers. The veneers

shall offer appreciable resistance to separation and the fractured samples shall show some adherent fibres distributed more or less uniformly.

NOTE — If a definite result is not obtained by the method described in IS 1734 (Part 4), the result of knife test described in IS 1734 (Part 5) shall be considered as decisive. In case of even number of plies where the grains of central plies follow the same direction, the result as obtained from knife test shall be considered final.

10.1.3 Resistance to Water Test

Six test pieces each approximately 250 mm × 100 mm, shall be cut from any position in the board such that the grains of the face veneer are parallel to the length of the piece. Six test specimens from each pair of glue lines shall be prepared as given in IS 1734 (Part 4). The specimens shall be subjected to any one of the tests specified in **10.1.3.1** and **10.1.3.2**.

10.1.3.1 The specimens shall be kept submerged horizontally in a pan of boiling water for a period of 72 h. The period of 72 h of boiling may be a continuous period or an aggregate of smaller periods of boiling, if the test piece is left in cold water between these smaller periods. The test pieces shall then be removed from the boiling water and cooled down to room temperature by plunging them in cold water. These test specimens, while still in wet condition, shall be subjected to tests described under **10.1.3.1.1** and **10.1.3.1.2**.

10.1.3.1.1 Glue shear strength

When tested for glue shear strength by the method described in IS 1734 (Part 4), the average failing load shall be not less than the corresponding values specified in Table 1.

10.1.3.1.2 Adhesion of plies

Adhesion shall be tested by knife test method described in IS 1734 (Part 5). The adhesion of plies may also be tested by forcibly separating the layers; the veneers shall offer appreciable resistance to separation and the fractured sample shall show some adherent fibres distributed more or less uniformly.

NOTE — In case a definite result is not obtainable by the method described in IS 1734 (Part 4), the result of knife test described in IS 1734 (Part 5) shall be considered as decisive. In case of even number of plies where the grains of central plies follow the same direction the result as obtained from knife test shall be considered final.

10.1.3.2 The specimens shall be subjected to constant steam pressure for a definite duration inside a vacuum steam pressure test apparatus as described in Annex D and thereafter subjected to tests as per **10.1.3.1.1** and **10.1.3.1.2**.

10.1.4 Plywood for concrete shuttering work with plastic coating or with suitable overlay (*see 6.4*), after being subjected to 72 h boiling, shall not show any

softening, checking, cracking or deterioration of the surface layer.

10.1.5 Mycological Test

The test for resistance to micro-organisms shall be carried out by the method described in IS 1734 (Part 7). The test piece shall,

- a) show no appreciable signs of separation at the edges of the veneers, and
- b) comply with the requirements specified in **10.1.5.1** and **10.1.5.2**.

10.1.5.1 Glue shear strength

When tested for glue shear strength by the method described in IS 1734 (Part 4), the average failing load shall be not less than the corresponding values specified in Table 1.

10.1.5.2 Adhesion of plies

Adhesion shall be tested by knife test method described in IS 1734 (Part 5). The adhesion of plies may also be tested by forcibly separating the layers; the veneers shall offer appreciable resistance to separation and the fractured sample shall show some adherent fibres distributed more or less uniformly.

NOTE — In case a definite result is not obtainable by the method described in IS 1734 (Part 4), the result of knife test described in IS 1734 (Part 5) shall be considered as decisive. In case of even number of plies where the grains of central plies follow the same direction the result as obtained from knife test shall be considered final.

10.1.6 Tensile Strength

The tensile strength, when determined by the method described in IS 1734 (Part 9), shall comply with the following requirements:

- a) Tensile strength shall be not less than 32.5 N/mm² in the direction parallel to the grain direction of the face veneers,
- b) Tensile strength shall be not less than 22.5 N/mm² in the direction at right angles to the grain direction of the face veneers, and
- c) The sum of the tensile strengths in both directions shall be not less than 60.0 N/mm².

10.1.7 Static Bending Strength

Three test specimens taken in each direction from the sample of plywood, when tested in accordance with IS 1734 (Part 11) shall have an average and a minimum individual modulus of elasticity and modulus of rupture not less than the values specified in Table 2.

10.1.8 Wet Bending Strength

Three test specimen taken in accordance with IS 1734 (Part 11) and from each direction of a sample of plywood, shall be subjected to cyclic test for 3 cycles, each cycle consisting of 4 h boiling in water and 16 h drying in an oven at 65 ± 2°C or shall be subjected to 72 h of boiling in water. The samples shall be then kept in water at 27 ± 2°C for 1 h and thereafter tested as per IS 1734 (Part 11). The duration of boiling/drying in oven may be split into shorter intervals by keeping

Table 1 Minimum Average Failing Load and Percentage Wood Failure Requirements of Structural Plywood
(Clauses 10.1.2.1, 10.1.3.1.1 and 10.1.5.1)

SI No.	Average Wood Failure	Average Failing Load, N		
		Dry State	Resistance to Water	Resistance to Micro-organisms
(1)	Percent (2)	(3)	(4)	(5)
i)	No requirement	≥ 1 350	≥ 1 000	≥ 1 000
ii)	Not less than 60	1 250-1 349	900-999	900-999
iii)	Not less than 80	1 100-1 249	800-899	800-899
iv)	Sample to be considered as failed	< 1 100	< 800	< 800

Table 2 Average and Minimum Individual Values of Modulus of Elasticity (MOE) and Modulus of Rupture (MOR) in Static Bending Strength
(Clause 10.1.7)

SI No.	Grain Direction	MOE, N/mm ²		MOR, N/mm ²	
		Average	Minimum Individual	Average	Minimum Individual
(1)	(2)	(3)	(4)	(5)	(6)
i)	Along (parallel to the grain direction of the face veneer)	7 500	6 700	50	45
ii)	Across (perpendicular to the grain direction of the face veneer)	4 000	3 600	30	27

the samples in room temperature at $27 \pm 2^\circ\text{C}$, in water (in case of boiling) or in air (in case of drying). The sample shall have an average and minimum individual modulus of elasticity and modulus of rupture not less than the values specified in Table 3.

Table 3 Minimum Average and Minimum Individual Values of Modulus of Elasticity (MOE) and Modulus of Rupture (MOR) for Wet Bending Strength

Sl No.	Property	Along the Face Grain (3)	Across the Face Grain (4)
(1)	(2)	(3)	(4)
i)	Modulus of elasticity, N/mm^2 :		
	a) Average	3 750	2 000
	b) Minimum Individual	3 400	1 800
ii)	Modulus of rupture, N/mm^2 :		
	a) Average	25	15
	b) Minimum Individual	22	13

10.1.9 Retention of Preservative

Plywood shall be treated as per 6.6 and shall have a retention of not less than 12 kg/m^3 , when tested in accordance with IS 2753 (Part 1).

10.2 Re-test

If any specimen fails to fulfil the test requirements specified under 10.1.1 to 10.1.9, a further two sets of samples on the basis prescribed in 9 shall be selected by the purchaser from the same batch and tested in the same manner. Test specimens prepared from these two further samples shall comply with the requirements specified in 10, otherwise the batch shall be rejected.

11 ADDITIONAL REQUIREMENTS FOR ECO-MARK

11.1 General Requirements

11.1.1 The plywood shall conform to the requirements of quality and performance as specified in this standard.

11.1.2 The manufacturer shall produce to BIS environmental consent clearance from the concerned State Pollution Control Board as per the provisions of the *Water (Prevention and Control of Pollution) Act, 1974* and *Air (Prevention and Control of Pollution) Act, 1981* and *Water (Prevention and Control of Pollution) Cess Act, 1977* alongwith the authorization, if required under the *Environment (Protection) Act, 1986*, while applying for ECO-Mark appropriate with enforced Rules and Regulations of Forest department.

11.2 Specific Requirements

The plywood shall conform to the specific requirements given for ECO-Mark under relevant clauses of the standard.

NOTE — The manufacturer shall provide documentary evidence by way of certificate or declaration to Bureau of Indian Standards while applying for ECO-Mark.

12 MARKING

12.1 Each plywood board shall be legibly and indelibly marked or stamped with the following particulars:

- Manufacturer's mark of identification,
- Year of manufacture,
- Type of plywood (*see 4*), and
- The criteria for which the plywood has been labelled as ECO-Mark.

12.2 BIS Certification Marking

Each plywood panel may also be marked with the Standard Mark.

12.2.1 The use of the Standard Mark is governed by the provisions of *Bureau of Indian Standards Act, 1986* and the Rules and Regulations made thereunder. The details of conditions under which the licence for the use of the Standard Mark may be granted to manufacturers or producers may be obtained from the Bureau of Indian Standards.

13 INFORMATION TO BE SUPPLIED BY THE MANUFACTURER

The manufacturer shall supply on demand to the purchaser full technical data and recommended method of use and loading. This information shall cover in particular the following:

- Type of adhesives used;
- Type of preservative used;
- Radii to which the plywood of given dimensions is recommended as bendable for architectural concrete work;
- Loading and deflection tables for the purpose of calculating the supports, that is, the sizes of bearers and distances of bearers;
- Density or mass per square metre of the plywood; and
- Species of timber.

ANNEX A

(Clause 2)

LIST OF REFERRED INDIAN STANDARDS

IS No.	Title	IS No.	Title
707 : 1974	Glossary of terms applicable to timber technology and utilization (<i>second revision</i>)	(Part 9) : 1983	Determination of tensile strength (<i>second revision</i>)
848 : 2006	Specification for synthetic resin adhesives for plywood (phenolic and aminoplastic) (<i>second revision</i>)	(Part 11) : 1983	Determination of static bending strength (<i>second revision</i>)
1734	Methods of test for plywood:	2753	Methods for estimation of preservatives in treated timber and in treating solutions: Part 1 Determination of copper, arsenic, chromium, zinc, boron, creosote and fuel oil (<i>first revision</i>)
(Part 1) : 1983	Determination of density and moisture content (<i>second revision</i>)	(Part 1) : 1991	Determination of copper, arsenic, chromium, zinc, boron, creosote and fuel oil (<i>first revision</i>)
(Part 4) : 1983	Determination of glue shear strength (<i>second revision</i>)	5539 : 1969	Specification for preservative treated plywood
(Part 5) : 1983	Test for adhesion of plies (<i>second revision</i>)	7638 : 1999	Wood/Lignocellulosic based panel products — Methods of sampling (<i>second revision</i>)
(Part 7) : 1983	Mycological test (<i>second revision</i>)		

ANNEX B

(Clause 5.1)

TIMBER SPECIES

Sl No.	Trade Name	Botanical Name	Abbreviation	Sl No.	Trade Name	Botanical Name	Abbreviation
1.	Aini	<i>Artocarpus hirsutus</i>	AIN	20.	Didu	<i>Salmalia insignis</i>	DID
2.	Alder	<i>Alnus nitida</i>	ALD	21.	Dillenia	<i>Dillenia</i> spp.	DIL
3.	Alder	<i>Alnus</i> spp.	ALD	22.	Ebony	<i>Diospyros</i> spp.	EBO
4.	Amari	<i>Amoora</i> spp.	AMA	23.	Elm	<i>Ulmus-wallichiana</i>	ELM
5.	Amra	<i>Spondias</i> spp.	AMR	24.	Gamari	<i>Gmelina arborea</i>	GAM
6.	Arjun	<i>Terminalia arjuna</i>	ARJ	25.	Garuga	<i>Garuga pinnata</i>	GAU
7.	Bahera	<i>Terminalia belerica</i>	BAH	26.	Gokul	<i>Ailanthus grandis</i>	GOK
8.	Banati	<i>Lophopetalum wightianum</i>	BAN	27.	Gurjan	<i>Dipterocarpus</i> spp.	GUR
9.	Birch	<i>Betula</i> spp.	BIR	28.	Gutel	<i>Trewia nudiflora</i>	GUT
10.	Bonsum	<i>Phoebe</i> spp.	BON	29.	Haldu	<i>Adina cordifolia</i>	HAL
11.	Carallia	<i>Carallia brachiata</i> (Syn. <i>Carallia integerrima</i>)	CAR	30.	Hathi-paila	<i>Pterospermum acerifolium</i>	HAT
12.	Champ	<i>Michelia</i> spp.	CHM	31.	Hollock	<i>Terminalia myriocarpa</i>	HOL
13.	Chaplash	<i>Artocarpus chaplasha</i>	CHP	32.	Hollong	<i>Dipterocarpus macrocarpus</i>	HON
14.	Chatian	<i>Alstonia scholaris</i>	CHT	33.	Indian Oak	<i>Quercus semecarpifolia</i>	IOA
15.	Chikrassy	<i>Chukrasia tabularis</i>	CHI	34.	Indian Oak	<i>Quercus dilatata</i>	IOA
16.	Chilauni	<i>Schima wallichii</i>	CHL	35.	Indian Oak	<i>Quercus serrata</i>	IOA
17.	Cinnamon	<i>Cinnamomum cecicodaphne</i>	CIN				
18.	Debdaru	<i>Polyalthia</i> spp.	DEB				
19.	Dhup	<i>Canarium</i> spp.	DHU				

Sl No.	Trade Name	Botanical Name	Abbreviation	Sl No.	Trade Name	Botanical Name	Abbreviation
36.	Jaman	<i>Syzygium</i> spp.	JAM	64.	Poon	<i>Colopyllum</i> spp.	POO
37.	Jhingan	<i>Lannea coromandelica</i> (Syn. <i>Lannea grandis</i>)	JHI	65.	Poplar	<i>Populus ciliata</i>	POP
38.	Jutili	<i>Altingia excelsa</i>	JUT	66.	Poplar	<i>Populus deltoides</i>	POP
39.	Kadam	<i>Anthocephalus cadampa</i>	KAD	67.	Pula	<i>Kydia calycina</i>	PUL
40.	Kanju	<i>Holoptelea integrifolia</i>	KAN	68.	Pussur	<i>Xylocarpus molluccensis</i>	PUS
41.	Karani	<i>Culltenia rosayroana</i> (Syn. <i>Cullenia excelsa</i>)	KAR	69.	Pyinma	<i>Lagerstroemia hypoleuca</i>	PYI
42.	Kathal	<i>Artocarpus heterophyllus</i>	KAT	70.	Red Bombwe	<i>Planchonia valida</i> (Syn. <i>Planchonia andamanica</i>)	RBO
43.	Kindal	<i>Terminalia paniculata</i>	KIN	71.	Red Dhup	<i>Parishia insignis</i>	RDH
44.	Kokko	<i>Albizia lebbek</i>	KOK	72.	Rose wood	<i>Dalbergia Latifolia</i>	ROS
45.	Lampati	<i>Duabanga grandiflora</i>	LAP	73.	Salai	<i>Bosweillia serrata</i>	SAA
46.	Laurel	<i>Terminalia tomentosa</i>	LAU	74.	Satin wood	<i>Chloroxylon swietenia</i>	SAT
47.	Litsa	<i>Liteasa polyantha</i>	LIT	75.	Seleng	<i>Sapium baccatum</i>	SEL
48.	Machilus	<i>Machilus</i> spp.	MAC	76.	Semul	<i>Salmolia malabrica</i>	SEM
49.	Mahogany	<i>Swietenia</i> spp.	MAG	77.	Silver Oak	<i>Grevillea robusta</i>	SOA
50.	Maina	<i>Teterameles nudiflora</i>	MAI	78.	Sissoo	<i>Dalbergia sissoo</i>	SIS
51.	Makai	<i>Shorea assamica</i>	MAK	79.	Teak	<i>Tectona grandis</i>	TEA
52.	Mango	<i>Mangifera indica</i>	MAN	80.	Toon	<i>Cedrela</i> spp.	TOO
53.	Maple	<i>Acer</i> spp.	MAP	81.	Udal	<i>Firmiana villosa</i> (Syn. <i>Sterculia villosa</i>)	UDA
54.	Menudito	<i>Enterolobium</i> spp. (Exotic)	MEN (ENT)	82.	Uriam	<i>Bischofia javanica</i>	URI
55.	Mullilam	<i>Fagara budrunga</i> (Syn. <i>Zanthoxylum rhetsa</i>)	MUI	83.	Vellapine	<i>Vateria indica</i>	VEL
56.	Mundani	<i>Acrocarpus fraxinifolius</i>	MUN	84.	Walnut	<i>Juglans</i> spp.	WAL
57.	Narikel	<i>Pterygota alata</i>	NAR	85.	White Bombwe (badam)	<i>Terminalia procera</i>	WBO
58.	Neem	<i>Azadirachta indica</i>	NEE	86.	White Cedar	<i>Dysoxylum malabricum</i>	WCE
59.	Nodunari	<i>Mansonia</i> spp.	NED	87.	White Chuglam (Sapwood)	<i>Terminalia bialata</i>	WCH
60.	Pali	<i>Paiquium ellipticum</i>	PAL				
61.	Persian Lilach	<i>Melia azadarach</i>	PLI				
62.	Piney	<i>Kingiodendron pinnatum</i> (Syn. <i>Hardwickia pinnata</i>)	PIN				
63.	Pitraj	<i>Aphanamixis polystachya</i>	PIT				

ANNEX C

(Clause 7.4)

METHOD OF TEST FOR EDGE STRAIGHTNESS AND SQUARENESS

C-1 PROCEDURE FOR EDGE STRAIGHTNESS

The straightness of the edges and ends of plywood shall be verified against a straight edge not less than the full length of the plywood. If the edge on the end of the plywood is convex, it shall be held against the straight edge in such a way as to give approximately equal gap at each end. The largest gap between the straight edge

and the edge shall be measured to the nearest millimetre and recorded.

C-2 PROCEDURE FOR SQUARENESS

The squareness of plywood shall be checked with a square with arms 500 mm long, by applying one arm of the square to the plywood. The maximum width of the gap shall be recorded.

ANNEX D
(Clause 10.1.3.2)

ALTERNATE METHOD FOR WATER RESISTANCE TEST

D-1 Pure water shall be filled in boiler of the vacuum steam pressure test (VPT) apparatus as shown in Fig.1 to the marking of minimum water level on glass water level indicator and the boiler shall be switched on with the valve connecting the boiler and main chamber in closed condition. The test specimens shall be placed in the working (main) chamber and shall be closed air tight with cover. The vacuum pump shall then be switched on and vacuum inlet valve shall be kept in open condition. The steam release valve shall be kept in closed condition. After the required vacuum of 110_{-0}^{+10} kPa has been created inside the main chamber,

the vacuum pump shall be switched off, the vacuum inlet valve closed and boiler valve connected to main chamber opened. The time shall be noted the moment the steam pressure in the main chamber reaches 220_{-0}^{+10} kPa and same pressure shall be maintained for 6 h. The system and boiler then shall be switched off. The steam release valve and vacuum release value shall slowly be opened until the steam in the chamber is completely evacuated. The samples shall then be kept in water for 1 h at 27 ± 2 °C. The samples shall thereafter be tested as per **10.1.3.1.1** and **10.1.3.1.2**.

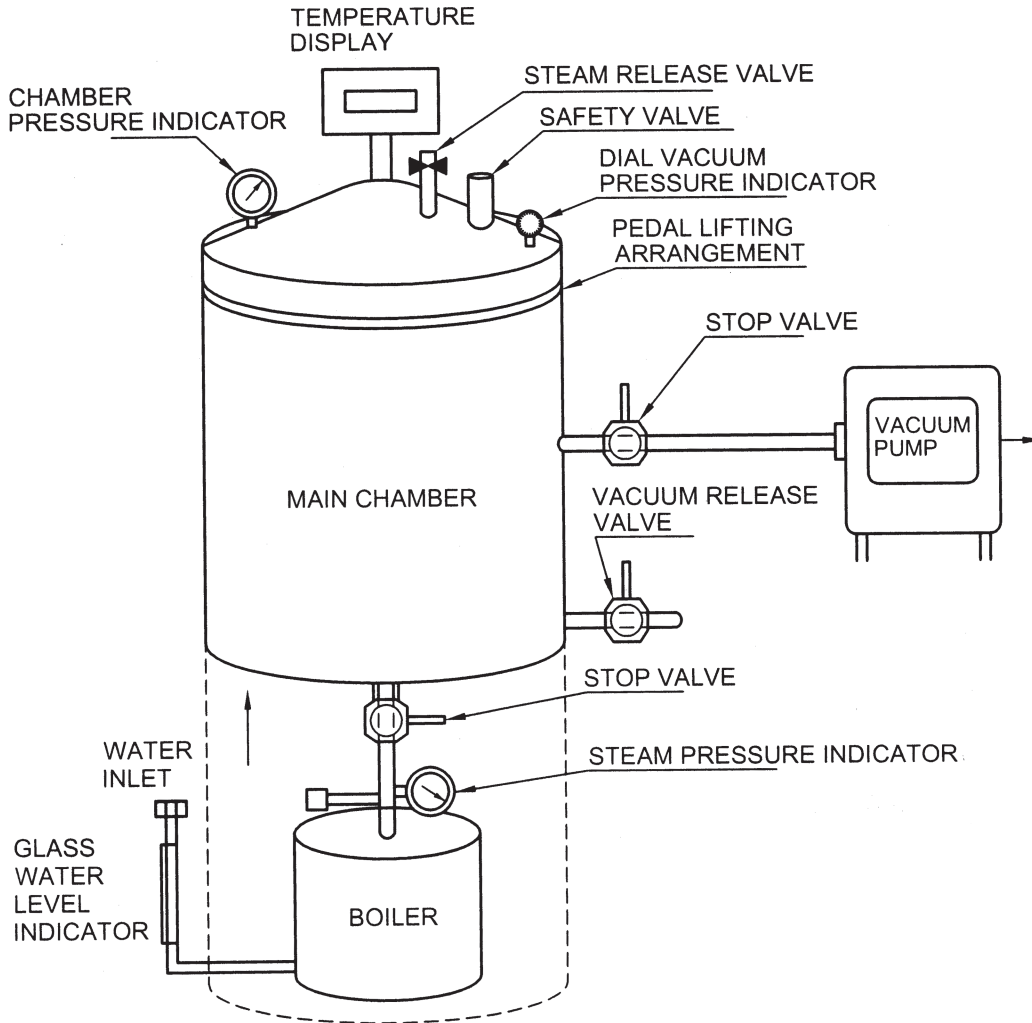


FIG. 1 VACUUM STEAM PRESSURE TEST (VPT) APPARATUS

ANNEX E

(Foreword)

RECOMMENDED METHOD OF HANDLING, STORING AND USE OF PLYWOOD FOR CONCRETE SHUTTERING AND FORM WORK

E-1 GENERAL

E-1.1 Plywood for concrete shuttering work is a preservative treated, BWP-bonded plywood and has its economy in use for concrete shuttering because of its re-use value. It is claimed that concrete shuttering plywood is capable of being re-used many times. However, the re-use value of the plywood depends on the care taken in handling the boards and following the manufacturer's instructions.

E-1.1.1 Another important advantage claimed for plywood for concrete shuttering works is that it gives to the concrete work smooth surface, requiring very little additional plastering. The retention of this quality of plywood again depends on the care taken during use. Cleaning of the surface of the plywood and oiling occasionally, go a long way in increasing the life of the plywood. The large sized panels in which the plywood is available increases economy, but only if nails and screws are fixed carefully and not allowed to unduly damage the plywood. Plywood for concrete shuttering has an advantage over steel sheeting in very hot or very cold climatic conditions as the external heat or cold does not penetrate through plywood as it does in case of metal sheeting.

E-2 RECEIVING AND STORING

E-2.1 At the time of dispatch from the factory, the plywood panels shall be carefully loaded to prevent any damage. Extra care should be taken in the case of coated and film faced plywood to avoid any scratches. Preferably a sheet of thick water proof paper/polythene sheet may be inserted between the two surfaces to prevent scratches. The plywood should be properly secured and covered with tarpaulin to ensure delivery to destination in clean and serviceable condition.

E-2.2 The plywood panels shall be unloaded carefully from the carrier truck or wagon. These shall be lifted, carried and stacked in a careful manner to avoid damage to the corners of surfaces. These shall be stored in packs on a level, flat and raised surface in a clean, dry and covered place with free circulation of air. The boards and stacks shall be protected from rain and dampness. The edges of a board in a pack shall be in a straight vertical line. The top of the stack shall be covered with a cover board and weighed down suitably.

E-2.2.1 The plywood panels shall not be dragged

particularly those supplied with plastic coating or with suitable overlay, over one another as this would scratch the surface if the edges are dragged on faces or any extraneous matter like sand or small stone particles lie in between the surfaces.

E-3 OILING THE SURFACE

Plywood for concrete shuttering work gives much longer service life if the surfaces are coated with suitable mould oil which acts both as a parting agent and also gives surface protection. The mould oil for use in coating of the plywood should have the following basic characteristics:

- a) It shall be a solution of preservative in a heavy mineral oil with a viscosity of 70-80 centipoise.
- b) It shall be free from dark and other suspended particles and shall be of light grey colour.

Some manufacturers supply the boards already shop-coated with mould oil. After 3-4 uses and also in cases when plywood has been stored for a long time, it should be re-coated with mould oil before the next use.

Cut edges of the plywood at the time of making concrete former should also be coated with suitable sealants like chlorinated rubber paint, for longer life of the board.

E-4 DRYING OF PANELS

The plywood for concrete shuttering work may be used repeatedly. However, if it has to be stored for a long time after one use, the panels should be dried by stacking in free circulation of air and on suitable spacers before storage.

E-5 DESIGN DATA

E-5.1 The following data are generally applicable to plywood for concrete shuttering work. However, as the species of timber used vary from manufacturer to manufacturer and with that the density and strength, the instructions of the manufacturers would be helpful for individual cases.

E-5.1.1 *Mass*

Generally, density of plywood for concrete shuttering work may be taken as 650 kgf/m³. The mass per m² in various thickness is given below:

<i>Thickness</i> mm (1)	<i>Mass</i> kg/m ² (2)
6	3.90
9	5.85
12	7.80
19	12.35
25	16.25

NOTE — When in wet condition, the mass may increase by 30 percent or more. The accuracy of the above mass can be taken only within a tolerance of ± 10 percent because of varying species and also variation in the moisture content.

E-5.2 Loading and Deflection

Taking the maximum permitted deflection as 1 : 270 (that is 1/270th of the span between the bearers), the following loads, in kg/m², are arrived at; the maximum load permitted is given provided that the face grain of the plywood is perpendicular to the length of bearers:

<i>Centre Distance of Bearers (Span)</i> mm (1)	<i>9 mm Thickness</i> kg/m ² (2)	<i>12 mm Thickness</i> kg/m ² (3)
300	1 270	1 950
400	540	850
450	320	640
600	170	360

E-5.2.1 When the face grain of plywood is parallel to the bearers, the permissible load may be as follows:

<i>Centre Distance of Bearers (Span)</i> mm (1)	<i>9 mm Thickness</i> kg/m ² (2)	<i>12 mm Thickness</i> kg/m ² (3)
300	760	1 220
400	320	540
450	195	390
600	110	170

NOTES

1 The above loads apply when the concrete is laid on concrete shuttering plywood as in slabs and beams. The same thickness of concrete in a wall can be held without excess deflection by thinner boards.

2 The maximum loads should be reduced to 75 percent, if wet boards are used.

E-5.3 Bending Radii

The following are approximately the minimum bending radii for plywood for concrete shuttering work, when dry:

<i>Thickness</i> mm (1)	<i>Across the Grain</i> m (2)	<i>Parallel with the Grain</i> m (3)
6	0.90	1.25
9	1.65	2.15
12	2.55	3.30

E-5.3.1 Plywood without any plastic coating or suitable overlay may be bent to still smaller radii by soaking in cold or hot water (temperature up to 70°C) before fixing.

E-5.4 Fixing

It is advised that, wherever possible, screws or nuts and bolts are used for fixing. While handling, scratching by screws, nuts and bolts or other metal fixtures should be avoided. This is particularly so in case of plywood with plastic coating or with suitable overlay.

E-6 CONSTRUCTION

E-6.1 Concrete shuttering formers for columns, piers, walls and other vertical surfaces are usually made from the plywood by fixing the same on to a backing framework of timber or iron. The timber frame members can be joined end to end by butt joint or lap joint or mitred joint. The shuttering plywood should be screwed or nailed to the framework. When designing the formers, these shall be made in the form of shooks to be joined side to side by suitable nuts and bolts spaced at suitable distances. This would permit easy assembly and dismantling of the former and reassembling for second use. Steel frameworks may be of angled iron or channel section suitably fabricated and braced to which shuttering plywood can be fixed either by nuts and bolts or by screws, the latter driven from the steel frame side. As an illustration, a concrete former box for a column is made in the form of four shooks or frames one for each side. The plywood is so fixed on to the timber or steel framework that it gives a flush surface on the inside. The four-side frames are assembled into box form by use of nuts and bolts at appropriate distances, where holes have been drilled earlier. After the concrete is poured and kept for the prescribed time, the former can be disassembled by opening the nuts and bolts fixed on the sides and reassembled or refixed for the second use with the same nuts and bolts.

E-6.2 Concrete formers for concrete walls or other broad vertical surface works may be similarly made in the form of wood or iron frames fixed with shuttering plywood panels. The two wide side surfaces on the two sides of a wall can be further secured to avoid a

sag at intermediate places by use of nut and bolts through the concrete. This would keep the former frames from spreading out. Such intermediate nuts and bolts may be removed after 48 h of concrete pouring and the hole in the wall later on plugged with concrete. The bolts may also be left in and later on cut out at the protruding portions. An alternative method would be the provision of well-designed additional supports and props outside. Formers, if required on one side only of a wall as in underground tanks and sewers, should be similarly made and suitably supported.

E-6.3 In case of concrete slabs, the concrete shuttering plywood may be laid without any framework on suitable bearers and assembled side by side with suitable fixing cleats to avoid any ridge formation in the concrete work at the joint. Dismantling may be done by carefully removing the props and beams from one side. Some users prefer use of backing frame work even for horizontal slabs and beams. Backing framework may be made of wood or steel.

E-6.4 For concrete beams, box formers are made as in **E-6.1** and then suitably supported by props.

E-6.5 Some users use steel framework into which plywood may be slid just in the same way as pressed steel shuttering sheets. The plywood for use as shuttering in such cases should be cut to the size of the recess or to the required shape and rested into the position like shuttering steel sheets.

E-6.6 The supporting structure for the plywood shuttering should be adequately strong. The design data given under **E-5.2** provides some guidance to design these supports.

E-6.7 Many users use thin sheets of plywood for

concrete shuttering as linings over conventional timber shuttering. The advantage gained by this is, primarily, a uniform, smooth surface on the concrete work. Care should be taken in such cases that the level of timber battens is reasonably correct to take the maximum advantage of getting a uniform and smooth surface finish of concrete work.

E-6.8 When used for architectural concrete and curved forms, the data given in **E-5.3** should be used to design the curved surfaces of the formers.

E-6.9 When removing concrete formers or sheets, care should be taken to carry out the parting, sliding and lowering carefully to avoid damage.

E-6.10 Plywood supplied with suitable overlay requires handling with special care to avoid scratching of the surface as scratches on the surface take away the advantage of surface overlay. The sheets after each use shall be cleaned of any sticking sand or aggregate.

E-7 PRECAUTIONS

E-7.1 After work at one site is over, the plywood used should be dried and sent to stores, or taken for re-use elsewhere. If a builder has finished work and does not want to store the plywood for long, the same could be disposed off to another builder for shuttering work or may be used as plywood of non-decorative type for general purpose.

E-7.2 There is a tendency in builders to cut plywood to shorter sizes for convenient handling. This should be discouraged as the greatest advantage of plywood for concrete shuttering is in its availability in large sizes leading to smooth ridge-free concrete work, thus saving in the expenses of elaborate plastering.

ANNEX F (Foreword)

COMMITTEE COMPOSITION

Wood and Other Lignocellulosic Products Sectional Committee, CED 20

<i>Organization</i>	<i>Representative(s)</i>
Indian Plywood Industries Research & Training Institute, Bangalore	DR C. N. PANDEY (<i>Chairman</i>)
Bamboo Society of India, Bangalore	SHRI N. S. ADKOLI SHRI A. S. SADASHIVAIAH (<i>Alternate</i>)
Building Materials & Technology Promotion Council, New Delhi	SHRI J. K. PRASAD SHRI A. K. TIWARI (<i>Alternate</i>)
Central Building Research Institute, Roorkee	DR S. P. AGARWAL DR B. S. RAWAT (<i>Alternate</i>)
Central Public Works Department, New Delhi	SHRI SURINDER KUMAR SHRI S. K. VERMA (<i>Alternate</i>)
Century Plyboard India Ltd, Kolkata	SHRI AJAY BALDAWA SHRI NIKHILESH ROY CHOWDHURY (<i>Alternate</i>)
Coir Board, Bangalore	SHRI M. SUDHAKARAN PILLAI SHRI R. VASUDEV (<i>Alternate</i>)
Directorate General of Supplies & Disposals, Hyderabad	SHRI M. GANGARAJU
Directorate of Standardization, New Delhi	DR (SHRIMATI) INDU GUPTA SHRI G. K. SHARMA (<i>Alternate</i>)
Engineer-in-Chief's Branch, New Delhi	SHRI N. B. SHELAR SHRI SANJAY MITTAL (<i>Alternate</i>)
Federation of Indian Plywood & Panel Industry, New Delhi	SHRI JAYADEEP CHITLANGIA
Forest Research Institute, Dehra Dun	DIRECTOR
Housing and Urban Development Corporation, New Delhi	SHRIMATI MANJU SAFAYA
Indian Academy of Wood Science, Dehra Dun	SECRETARY JOINT SECRETARY (<i>Alternate</i>)
Indian Plywood Industries Research & Training Institute, Bangalore	SHRI K. SHYAMASUNDAR SHRI M. VENUGOPAL NAIDU (<i>Alternate</i>)
Institute of Wood Science & Technology, Bangalore	DIRECTOR
Jolly Board, Mumbai	SHRI ARVIND JOLLY SHRI P. K. DAS GUPTA (<i>Alternate</i>)
Kerala State Bamboo Corporation Ltd, Ernakulam	SHRI M. R. ANIL KUMAR
Kutty Flush Door & Furniture Co Pvt Limited, Chennai	COL G. KRISHNAN SHRI K. SHANKARKRISHNAN (<i>Alternate</i>)
Mangalam Timber Products Limited, Bangalore	SHRI G. S. GUPTA SHRI R. KRISHNAN (<i>Alternate</i>)
Ministry of Defence (DGQA), Kanpur	SHRI NUSRAT ULLAH SHRI K. C. GUPTA (<i>Alternate</i>)
Ministry of Defence (R&D), New Delhi	SHRI RAVINDER KUMAR
Ministry of Railways, Lucknow	DIRECTOR ASSISTANT DIRECTOR (<i>Alternate</i>)
National Mission on Bamboo Application, New Delhi	SHRI SUNIL PANDEY
National Test House, Kolkata	SHRI ALOK DE SHRI S. THIRUMALAI KOLUNDU (<i>Alternate</i>)
Northern India Plywood Manufacturer Association, Jalandhar	SHRI N. K. TIWARI SHRI ANIL GOEL (<i>Alternate</i>)
Nuchem Limited, New Delhi	SHRI SUDEV BARAR SHRI JITESH NICHANI (<i>Alternate</i>)
Permalli Wallace Limited, Bhopal	SHRI S. K. KADESIA SHRI B. S. PARMAR (<i>Alternate</i>)

<i>Organization</i>	<i>Representative(s)</i>
Rajiv Gandhi Rural Housing Corporation Ltd, Bangalore	SHRI MAHADEVA PRASAD
The South Indian Plywood Manufacturers Association, Chennai	SHRI K. SANKARAKRISHNAN
The Western India Plywood Limited, Kannur	SHRI P. K. MOHAMED SHRI K. RAGHUNATHAN (<i>Alternate</i>)
Timber Development Association of India, Dehra Dun	REPRESENTATIVE
Timpack Pvt Limited, Byrnihat	DIRECTOR
BIS Directorate General	SHRI A. K. SAINI, Scientist 'F' & Head (CED) [Representing Director General (<i>Ex-officio</i>)]

Member Secretary
SHRI J. ROY CHOWDHURY
Scientist 'E' (CED), BIS

Plywood, Veneers and Adhesives for Wood Products Subcommittee, CED 20 : 1

In personal capacity (<i>1424, 'Kaundinya', 23rd Main Road, BSK II Stage, Bangalore 560070</i>)	SHRI B. S. ASWATHANARAYANA (<i>Convener</i>)
Allied Resins and Chemicals Limited, Kolkata	SHRI RAJESH MUNDRA SHRI ASHIM KUMAR DAS (<i>Alternate</i>)
Central Public Works Department, New Delhi	SUPERINTENDING ENGINEER EXECUTIVE ENGINEER (<i>Alternate</i>)
DGS&D, New Delhi	SHRI N. K. UPADHYAY
Directorate of Standardization, New Delhi	MAJOR S. S. BISHT SHRI B. S. NARULA (<i>Alternate</i>)
Federation of India Plywood and Panel Industry, New Delhi	REPRESENTATIVE
Forest Research Institute, Dehra Dun	DIRECTOR
Greenply Industries Limited, Kolkata	REPRESENTATIVE
Hunsur Plywood Works Pvt Limited, Hunsur	SHRI MOIZ VAGH
Indian Institute of Packaging, Mumbai	SHRI P. L. NAGARSEKAR SHRI DEEPAK KHEDKAR (<i>Alternate</i>)
Indian Plywood Industries Research and Training Institute, Bangalore	SHRI M. VENUGOPAL NAIDU SHRIMATI D. SUJATHA (<i>Alternate</i>)
Institute of Wood Science & Technology, Bangalore	DR R. V. RAO SHRI S. R. SHUKLA (<i>Alternate</i>)
Kitply Industries Limited, Tinsukia	SHRI ANIL BANKA SHRI F. L. SAHU (<i>Alternate</i>)
Kutty Flush Doors & Furniture Co Pvt Limited, Chennai	SHRI K. SANKARAKRISHNAN COL Y. G. KRISHNAN (<i>Alternate</i>)
Kanara Wood & Plywoods Industries Limited, Mangalore	SHRI P. H. G. REDDY SHRI Y. MOHAMMED FARHAAD (<i>Alternate</i>)
Ministry of Defence, Kanpur	SHRI V. B. TANDON
National Starch and Chemical ICI India Ltd, Navi Mumbai	SHRI RUBEN MOHAPATRA
National Test House, Kolkata	SHRIMATI S. A. KAUSHIL SHRIMATI RATNA SARKAR DE (<i>Alternate</i>)
Northern India Plywood Manufacturing Association, Jalandhar	SHRI N. K. TIWARI SHRI SARWAN KUMAR (<i>Alternate</i>)
Nuchem Limited, New Delhi	SHRI SUDEV BARAR SHRI JITESH NICHANI (<i>Alternate</i>)
Punjab Plywood Manufacturing Association, Chandigarh	SHRI RAJEEV SINGHAL SHRI SURINDER ARORA (<i>Alternate</i>)

IS 4990 : 2011

Organization

Sarda Plywood Industries Limited, Kolkata

South India Plywood Manufacturers Association, Kannur

The Western India Plywood Ltd, Kannur

In personal capacity (*H No. 12, HIG 1st Stage, KHB Colony,
Basaveswaranagar, Bangalore 560079*)

Representative(s)

SHRI SUNDEEP CHITLANGIA

SHRI ANIL KHAITAN (*Alternate*)

SHRI MOIZ VAGH

SHRI FERAZ ASGER ALI (*Alternate*)

SHRI P. K. MOHAMED

DR K. RAGHUNATHAN (*Alternate*)

SHRI S. S. ZOOLAGUD

Bureau of Indian Standards

BIS is a statutory institution established under the *Bureau of Indian Standards Act, 1986* to promote harmonious development of the activities of standardization, marking and quality certification of goods and attending to connected matters in the country.

Copyright

BIS has the copyright of all its publications. No part of these publications may be reproduced in any form without the prior permission in writing of BIS. This does not preclude the free use, in the course of implementing the standard, of necessary details, such as symbols and sizes, type or grade designations. Enquiries relating to copyright be addressed to the Director (Publications), BIS.

Review of Indian Standards

Amendments are issued to standards as the need arises on the basis of comments. Standards are also reviewed periodically; a standard along with amendments is reaffirmed when such review indicates that no changes are needed; if the review indicates that changes are needed, it is taken up for revision. Users of Indian Standards should ascertain that they are in possession of the latest amendments or edition by referring to the latest issue of 'BIS Catalogue' and 'Standards : Monthly Additions'.

This Indian Standard has been developed from Doc No.: CED 20 (7615).

Amendments Issued Since Publication

Amend No.	Date of Issue	Text Affected

BUREAU OF INDIAN STANDARDS

Headquarters:

Manak Bhavan, 9 Bahadur Shah Zafar Marg, New Delhi 110002
Telephones : 2323 0131, 2323 3375, 2323 9402 Website: www.bis.org.in

Regional Offices:

	Telephones
Central : Manak Bhavan, 9 Bahadur Shah Zafar Marg NEW DELHI 110002	{ 2323 7617 2323 3841
Eastern : 1/14 C.I.T. Scheme VII M, V. I. P. Road, Kankurgachi KOLKATA 700054	{ 2337 8499, 2337 8561 2337 8626, 2337 9120
Northern : SCO 335-336, Sector 34-A, CHANDIGARH 160022	{ 60 3843 60 9285
Southern : C.I.T. Campus, IV Cross Road, CHENNAI 600113	{ 2254 1216, 2254 1442 2254 2519, 2254 2315
Western : Manakalaya, E9 MIDC, Marol, Andheri (East) MUMBAI 400093	{ 2832 9295, 2832 7858 2832 7891, 2832 7892

Branches: AHMEDABAD. BANGALORE. BHOPAL. BHUBANESHWAR. COIMBATORE. DEHRADUN. FARIDABAD. GHAZIABAD. GUWAHATI. HYDERABAD. JAIPUR. KANPUR. LUCKNOW. NAGPUR. PARWANOO. PATNA. PUNE. RAJKOT. THIRUVANANTHAPURAM. VISAKHAPATNAM.